





Description

Metal Faced Meter Box, 2 Hour fire rated & Ambient Smoke Control Tested, Metal Door, 25mm wide Picture Frame, Budget Lock, 8mm Triangular Electrical Cabinet Insert, Single Door Unit, Ingress Protection Rating of IP43, Powder Coated RAL 9010 30% Gloss, Fully Powder Coated.


PRODUCT TYPE	FIRE RATING	SMOKE TESTED	DOOR TYPE	FRAME TYPE	MASTER LOCK TYPE	SECONDARY LOCK TYPE	NUMBER OF DOOR LEAVES	AIRTIGHT RATED	ACOUSTIC RATED
--------------	-------------	--------------	-----------	------------	------------------	---------------------	-----------------------	----------------	----------------

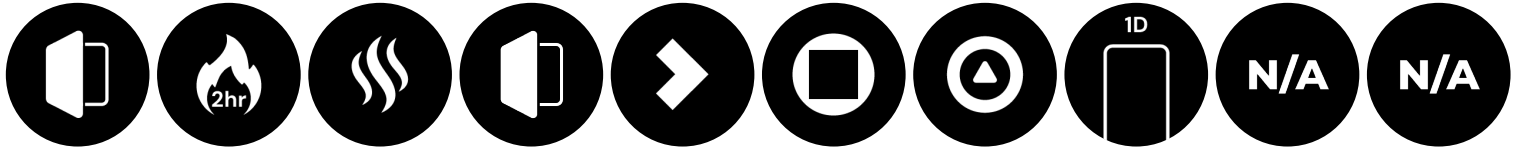

Section Drawing Height (H)

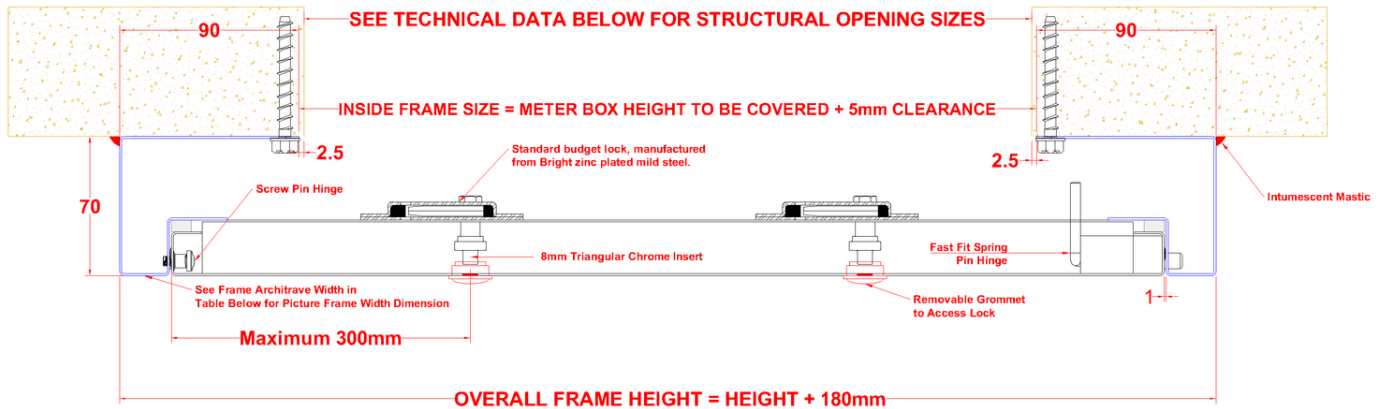

Section Drawing Width (W)

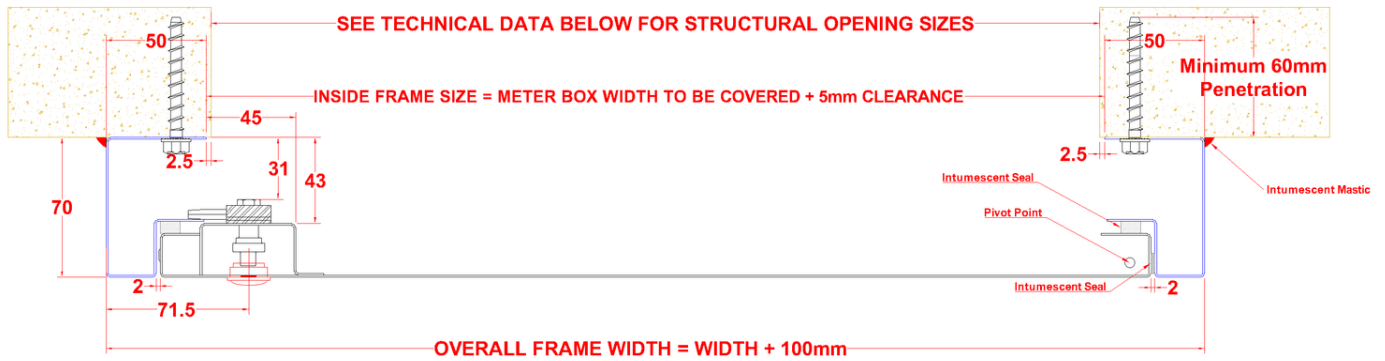

Indicative Product Images (Colour and door handing may differ from that shown)



Technical Data	
Wall or Ceiling or Both (Dual)	Wall
Fire Test Standard	• BS EN 1363-1: 2012 • BS EN 1634-1: 2014+A1:2018
Fire Performance Rating	• Integrity (E)
Fire Tested Side	• Wall application Rear (Services side / opening away from the fire risk side)
Fire Tested Size H x W mm	1070x650mm
Assessed Maximum Panel Sizes	Up to 15% increase in height, 15% width and up to 20% area.
Size range: Minimum to maximum (H x W mm). Fire Rated Panels: See assessed maximum panel sizes for allowable increases.	300x200mm up to 1070x650mm
Smoke Test Standard	BS EN 1634-3: 2004
Airtightness Tested	No Rating
Acoustic Tested	No Rating
IP Rating	Ingress Protection Rating of IP43: Objects larger than 1mm & Spraying water
Corrosion class C1, C2, C3, C4	C2 - Low: Exterior: Low-pollution rural environments. Interior: Unheated buildings prone to condensation, e.g. depots and sports halls.
Flexible Wall Types	• Currently not Covered
Rigid Wall Types	• The wall type shall provide a suitable medium to permit adequate fixity. • Other rated wall constructions, not listed below, may also be acceptable, subject to expert advice from a qualified fire consultant • Blockwork masonry or homogenous concrete constructions • Walls must provide fire resistance equal to the doorset's required performance period.
Shaftwall Types	• Currently not Covered
Mixed Construction Wall Types	• Currently not Covered
Ceiling Types	• Not Suitable for a Ceiling Application
Frame Fixing Types	• Masonry: Minimum 7.5mm x 60mm Countersunk Thread Forming Concrete Screws
Frame Fixing Hole Distance back from the Face of the Panel	• Overall Frame Depth
Permitted Gaps Between the Rear of the Frame and the Structural Opening	• 2.5mm Height x 2.5mm Width
Permitted Sealants	• Mann McGowan Pyromas A • Fire-tested alternative sealants to BS EN 1363-1 or BS EN 1634-1 for the required fire resistance duration and substrates in this application.
Application of Intumescent Sealants	• Applied Sealing the Rear of the Frame to the Structural Opening
Structural Opening Size	• Wall Structural Opening or Existing Overall Meter Box Size Height & Width
Panel Size Formula H x Wmm	Structural Opening or Existing Overall Meter Box Size +5mm
Clear opening size through the installed panel with the door leaf open at 90 degrees	• Panel Height - 0mm x Panel Width - 30mm
Composition / Manufacturing	
Quality Category	Mid Range
Product Design Category	Standard Product
Lock Security Level	Grade 2 – Standard Security
Frame Architrave Width (e.g. Picture / Beaded Frame)	• 25mm
Frame Steel Thickness	1.2mm
Door Steel Thickness	0.9mm

Door & Frame Material Grade	• Frame: Zintec Steel to BS EN 10152 : 2017 DC01 + ZE 25/25 • Door Leaf: Zintec Steel to BS EN 10152 : 2017 DC01 + ZE 25/25
Frame Depth	70mm
Available Frame Depths upon request	Minimum Dimension: 60mm to Maximum Dimension: 150mm
Board Infill Type	• None
Door Insulation Type	• None
Seal Type	• Norseal FS1000 Self Adhesive Intumescent Foam Tape • Sealed to All Door Closing Edges
Paint Type	• Polyester Powder Coated • RAL 9010 30% Gloss Pure white

Installation Guide

1) Open the door, release the spring pin hinge, and lift the door out of the frame.

2) Place the frame on top of the aperture, ensuring it's 5mm smaller than the panel / back of frame opening size.

3) Fix the frame on top of the aperture using all fixing holes, ensure it is square and flush with the wall.

4) Refit the door by relocating the spring pin hinge ensuring this is fully located then close the door.

5) Lock the door with the key, ensuring it is flush with the frame.

Apply a minimum of 5mm wide intumescent sealant bead to seal the back of the frame to the wall ensuring all gaps are sealed.

Independent bracing or support may be needed for the Meter Box weight.